


HRV700i Effectiveness Data

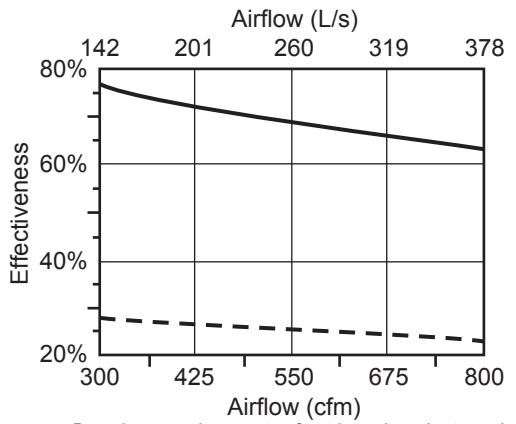

Based on equal amounts of outdoor air and return air.

- - - Total Effectiveness (Cooling)
- Sensible Effectiveness (Heating)
- n/a Latent Effectiveness (Heating)

Ratings outside the scope of the AHRI Energy Recovery Ventilation Certification Program.

Model Number: PHE500-19H-23S-0.12

Type: Plate

Nominal Airflow: 400 scfm

Pressure Drop: 0.25 inches

Leakage Ratings

	Pressure Differential	EATR	OACF	Purge Angle or Setting
Test 1:	-5.00 inches	0%	1.00	N/A
Test 2:	0.00 inches	0%	1.00	N/A
Test 3:	5.00 inches	0%	1.00	N/A

Thermal Effectiveness Ratings at 0" Pressure Differential

	Sensible	Latent	Total
100% Airflow Heating Condition:	76%	0%	50%
75% Airflow Heating Condition:	79%	0%	52%
100% Airflow Cooling Condition:	71%	0%	27%
75% Airflow Cooling Condition:	74%	0%	29%

	Net Sensible	Net Latent	Net Total
100% Airflow Heating Condition:	76%	0%	50%
75% Airflow Heating Condition:	79%	0%	52%
100% Airflow Cooling Condition:	71%	0%	27%
75% Airflow Cooling Condition:	74%	0%	29%



Energy recovery component is certified by AHRI to AHRI Standard 1060. Actual performance in packaged equipment may vary.